


**ARCHIVED POLLUTION MONITORING DATA**  
**DARLINGTON POINT SEWAGE TREATMENT SYSTEM**

Darlington Point Sewerage Treatment Works

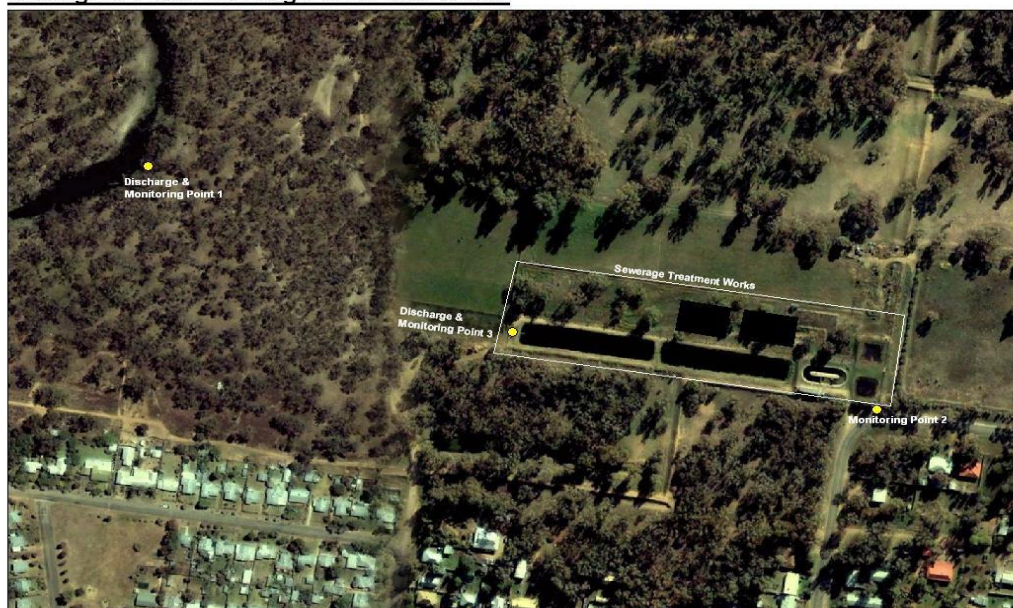

Link to full licence on EPA website:

<http://www.epa.nsw.gov.au/prpoeoapp/ViewPOEOLicence.aspx?DOCID=33729&SYSUID=1&ICID=6260>

Licensee: Murrumbidgee Council, PO Box 5 Darlington Point NSW 2706  
Address of Facility: Boyd Street, Darlington Point NSW

**Sampling Point 1**

**Date Sample:** 11 March 2024  
**Date Obtained:** 15 March 2024  
**Date Published:** 23 April 2024

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	29	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	6	10
Nitrate	Milligrams per litre	1.5	0.1
Oil and Grease	Milligrams per litre	1	10
pH	Milligrams per litre	6.8	6.5-8.5
Phosphorus (total)	Milligrams per litre	2.87	10
Faecal Coliforms	CFU/100ml	30	200
Total Kjeldahl Nitrogen	Milligrams per litre	4	2
Total Suspended Solids	Milligrams per litre	25	15

## Sampling Point 1

**Date Sample:** 5 December 2023

**Date Obtained:** 11 December 2023

**Date Published:** 21 December 2023

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	22	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	8	10
Nitrate	Milligrams per litre	0.1	0.1
Oil and Grease	Milligrams per litre	1	10
pH	Milligrams per litre	9.5	6.5-8.5
Phosphorus (total)	Milligrams per litre	1.89	10
Faecal Coliforms	CFU/100ml	10	200
Total Kjeldahl Nitrogen	Milligrams per litre	8	2
Total Suspended Solids	Milligrams per litre	6	15

## Sampling Point 1

**Date Sample:** 20 September 2023

**Date Obtained:** 25 September 2023

**Date Published:** 25 October 2023

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	27	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	4	10
Nitrate	Milligrams per litre	1.3	0.1
Oil and Grease	Milligrams per litre	1	10
pH	Milligrams per litre	7.9	6.5-8.5
Phosphorus (total)	Milligrams per litre	2.94	10
Faecal Coliforms	CFU/100ml	38	200
Total Kjeldahl Nitrogen	Milligrams per litre	3	2
Total Suspended Solids	Milligrams per litre	17	15

## Sampling Point 1

**Date Sample:** 13 June 2023

**Date Obtained:** 15 June 2023

**Date Published:** 11 July 2023

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	23	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	6	10
Nitrate	Milligrams per litre	0.6	0.1
Oil and Grease	Milligrams per litre	1	10
pH	Milligrams per litre	5.03	6.5-8.5
Phosphorus (total)	Milligrams per litre	7.5	10
Faecal Coliforms	CFU/100ml	6	200
Total Kjeldahl Nitrogen	Milligrams per litre	5	2
Total Suspended Solids	Milligrams per litre	27	15

## Sampling Point 1

**Date Sample:** 21 March 2023

**Date Obtained:** 20 April 2023

**Date Published:** 5 May 2023

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	4	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	<2	10
Nitrate	Milligrams per litre	0.1	0.1
Oil and Grease	Milligrams per litre	3	10
pH	Milligrams per litre	9.4	6.5-8.5
Phosphorus (total)	Milligrams per litre	2.26	10
Faecal Coliforms	CFU/100ml	56	200
Total Kjeldahl Nitrogen	Milligrams per litre	<2	2
Total Suspended Solids	Milligrams per litre	36	15

## Sampling Point 1

**Date Sample:** 06 December 2022

**Date Obtained:** 07 December 2022

**Date Published:** 10 January 2022

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	3	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	2	10
Nitrate	Milligrams per litre	<0.1	0.1
Oil and Grease	Milligrams per litre	1	10
pH	Milligrams per litre	10.2	6.5-8.5
Phosphorus (total)	Milligrams per litre	2.07	10
Faecal Coliforms	CFU/100ml	4890	200
Total Kjeldahl Nitrogen	Milligrams per litre	2	2
Total Suspended Solids	Milligrams per litre	8	15

## Sampling Point 1

**Location:** Sewerage Treatment Plant, Boyd Street

**Date Sample:** 20 September 2022

**Date Obtained:** 21 September 2022

**Date Published:** 7 October 2022

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	<2	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	3	10
Nitrate	Milligrams per litre	1	0.1
Oil and Grease	Milligrams per litre	<1	10
pH	Milligrams per litre	9.1	6.5-8.5
Phosphorus (total)	Milligrams per litre	3.94	10
Faecal Coliforms	CFU/100ml	600000	200
Total Kjeldahl Nitrogen	Milligrams per litre	2	2
Total Suspended Solids	Milligrams per litre	7	15

### Sampling Point 1

**Location:** Sewerage Treatment Plant, Boyd Street

**Date Sample:** 14 June 2022

**Date Obtained:** 9 July 2022

**Date Published:** 19 July 2022

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	10	10
Chlorine Residual – Free	Milligrams per litre	Not provided	0.5
Nitrogen (total)	Milligrams per litre	3	10
Nitrate	Milligrams per litre	0.2	0.1
Oil and Grease	Milligrams per litre	1	10
pH	Milligrams per litre	9.2	6.5-8.5
Phosphorus (total)	Milligrams per litre	3.73	10
Faecal Coliforms	CFU/100ml	66	200
Total Kjeldahl Nitrogen	Milligrams per litre	3	2
Total Suspended Solids	Milligrams per litre	26	15

### Sampling Point 1

**Location:** Sewerage Treatment Plant, Boyd Street

**Date Sample:** 5 May 2020

**Date Obtained:** 4 June 2020

**Date Published:** 18 June 2020

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	2	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	4	10
Nitrate	Milligrams per litre	1.8	0.1
Oil and Grease	Milligrams per litre	4	10
pH	Milligrams per litre	7.6	6.5-8.5
Phosphorus (total)	Milligrams per litre	3.73	10
Faecal Coliforms	CFU/100ml	740	200
Total Kjeldahl Nitrogen	Milligrams per litre	2	2
Total Suspended Solids	Milligrams per litre	13	15

### Sampling Point 1

**Location:** Sewerage Treatment Plant, Boyd Street

**Date Sample:** 28 January 2020

**Date Obtained:** 31 January 2020

**Date Published:** 13 March 2020

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	4	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	4	10
Nitrate	Milligrams per litre	<0.1	0.1
Oil and Grease	Milligrams per litre	3	10
pH	Milligrams per litre	9.2	6.5-8.5
Phosphorus (total)	Milligrams per litre	2.84	10
Faecal Coliforms	CFU/100ml	6	200
Total Kjeldahl Nitrogen	Milligrams per litre	4	2
Total Suspended Solids	Milligrams per litre	32	15

## Sampling Point 1

**Location:** Sewerage Treatment Plant, Boyd Street

**Date Sample:** 8 October 2019

**Date Obtained:** 14 October 2019

**Date Published:** 19 October 2019

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	<2	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	2	10
Nitrate	Milligrams per litre	0.5	0.1
Oil and Grease	Milligrams per litre	3	10
pH	Milligrams per litre	7.8	6.5-8.5
Phosphorus (total)	Milligrams per litre	1.98	10
Faecal Coliforms	CFU/100ml	<1	200
Total Kjeldahl Nitrogen	Milligrams per litre	2	2
Total Suspended Solids	Milligrams per litre	7	15

## Sampling Point 1

**Location:** Sewerage Treatment Plant, Boyd Street

**Date Sample:** 19 March 2019

**Date Obtained:** 20 March 2019

**Date Published:** 4 April 2019

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	5	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Conductivity	Microsiemens per centimetre		
Nitrogen (total)	Milligrams per litre	3	10
Nitrate	Milligrams per litre	<0.1	0.1
Oil and Grease	Milligrams per litre	1	10
pH	Milligrams per litre	9.4	6.5-8.5
Phosphorus (total)	Milligrams per litre	3.03	10
Faecal Coliforms	CFU/100ml	100	200
Total Kjeldahl Nitrogen	Milligrams per litre	3	2
Total Suspended Solids	Milligrams per litre	20	15

## Sampling Point 1

**Location:** Sewerage Treatment Plant, Boyd Street

**Date Sample:** 17 April 2017

**Date Obtained:** 19 April 2017

**Date Published:** 4 May 2017

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	9	10
Conductivity	Microsiemens per centimetre	749	
Nitrogen (total)	Milligrams per litre	5	10
Oil and Grease	Milligrams per litre	5	10
pH	Milligrams per litre	7.6	6.5-8.5
Phosphorus (total)	Milligrams per litre	6.95	10
Faecal Coliforms	CFU/100ml	5540	200
Total Suspended Solids	Milligrams per litre	68	15

## Sampling Point 1

Location: Sewerage Treatment Plant, Boyd Street

Date Sample: 14 March 2017

Date Obtained: 22 March 2017

Date Published: 24 March 2017

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	7	10
Conductivity	Microsiemens per centimetre	753	
Nitrogen (total)	Milligrams per litre	0.1	10
Oil and Grease	Milligrams per litre	<1	10
pH	Milligrams per litre	8.2	6.5-8.5
Phosphorus (total)	Milligrams per litre	1.7	10
Faecal Coliforms	CFU/100ml	490	200
Total Suspended Solids	Milligrams per litre	65	15

### Sampling Point

Location: Sewerage Treatment Plant, Boyd Street

Published: 20/10/16

Obtained: Quarterly

POLLUTANTS	Jul 2016	Oct 2016	100 Percentile Limit	Exceedance (yes/no)
Conductivity (uS/cm)	621	641		
Oil & Grease (mg/L)	1	<1		
pH (pH units)	8.2	7.9	6.5-8.5	No
Nitrogen (mg/L)	<0.1	3.5	10	No
Phosphorus (mg/L)	5.49	4	10	No
Faecal Coliforms (CFU/100mL)	7760	1120	200	Yes
Total Suspended Solids (mg/L)	42	22	15	Yes
Biochemical Oxygen Demand (mg/L)	4	3	10	No

### Sampling Point

Location: Sewerage Treatment Plant, Boyd Street

Published: May-16

Obtained: Quarterly from April 3,2015 to April 2, 2016

POLLUTANTS	Jul-15	Oct-15	Jan-16	Apr-16	Lowest	Mean	Highest	100 Percentile Limit	Exceedance (yes/no)
Conductivity (uS/cm)	635	706	831	751	635	730.75	831		
Oil & Grease (mg/L)	3	3	2	2	2	2.5	3		
pH (pH units)	8.1	9.4	8.8	8.2	8.1	8.625	9.4	6.5-8.5	Yes
Nitrogen (mg/L)	0.3	0.2	0.1	0.6	0.1	0.3	0.6	10	No
Phosphorus (mg/L)	4.36	3.86	3.84	4.85	3.84	4.2275	4.85	10	No
Faecal Coliforms (CFU/100mL)	6	8	350	35200	6	8891	35200	200	Yes

Total Suspended Solids (mg/L)	40	88	234	59	40	105.25	234	15	Yes
Biochemical Oxygen Demand (mg/L)	7	7	8	11	7	8.25	11	10	Yes

#### Sampling Point

**Location:** Sewerage Treatment Plant, Boyd Street  
**Published:** May-16  
**Obtained:** Quarterly from April 3, 2015 to April 2, 2016

POLLUTANTS	Jul-15
Available Phosphorous (mg/kg)	35
Electrical Conductivity (uS/m)	0.334
Exchangeable Calcium (cmol/kg)	13.2
Exchangeable Magnesium (cmol/kg)	9.78
Exchangeable Potassium (cmol/kg)	0.9
Exchangeable Sodium (cmol/kg)	3.69
Nitrate (mg/kg)	6
Nitrogen (Total) (mg/kg)	828
pH	8.2
Phosphorus (Total) (mg/kg)	300

#### Discharge & Monitoring Point 1

**Location:** Outlet to the backwater lagoon of the Murrumbidgee River (ADP001 & Diversion Point)  
**Published:** May 27, 2015

Item	Unit	Monitoring frequency required by licence	Min. value	Max. value	Volume limit	Exceedence (yes/no) (yes/no)
Daily Outflow to River	kl/day	Continuous	1	177	249	NO

#### Discharge & Monitoring Point 3

**Location:** Pipe Discharging to the effluent utilisation area marked as "Supply point"  
**Published:** May 27, 2015

Item	Unit	Monitoring frequency required by licence	Min. value	Max. value	Volume limit	Exceedence (yes/no) (yes/no)
Daily Outflow to Ron's Farm	kl/day	continuous	22	104	185	NO