


**CURRENT POLLUTION MONITORING DATA**  
**DARLINGTON POINT SEWAGE TREATMENT SYSTEM**

Darlington Point Sewerage Treatment Works

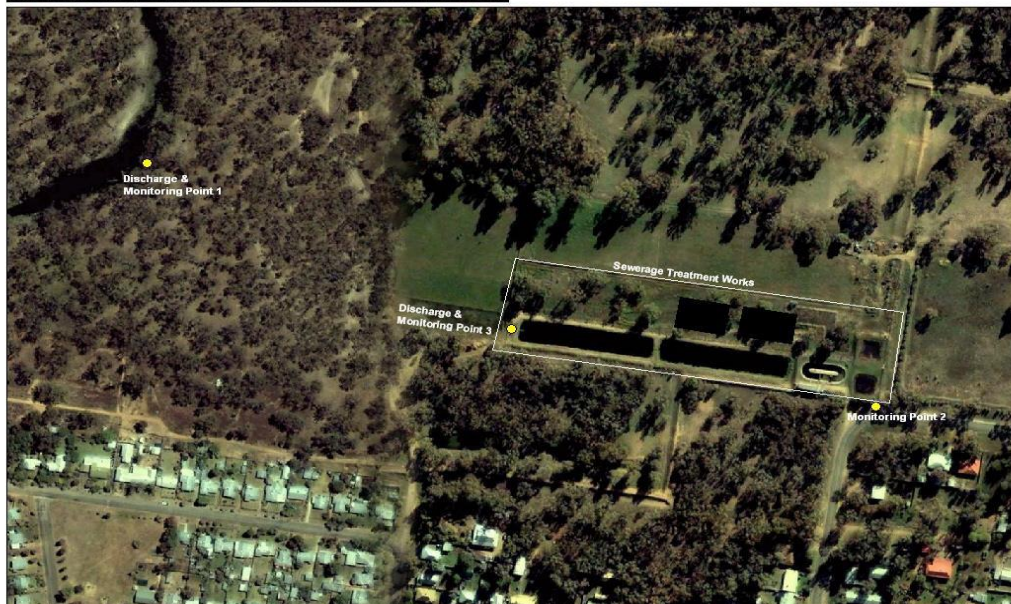

Environment Protection Licence No. : 169 6260

Link to full licence on EPA website:

<http://www.epa.nsw.gov.au/prpoeoapp/ViewPOEOLicence.aspx?DOCID=33729&SYSUID=1&LICID=6260>

Licensee: Murrumbidgee Council, PO Box 5 Darlington Point NSW 2706  
Address of Facility: Boyd Street, Darlington Point NSW

**Sampling Point 1**

**Date Sample:** 4 December 2024

**Date Obtained:** 5 December 2024

**Date Published:** 18 December 2024

Pollutant	Unit	Measurement	Licence Limits
Biochemical Oxygen Demand	Milligrams per litre	6	10
Chlorine Residual – Free	Milligrams per litre	<0.5	0.5
Nitrogen (total)	Milligrams per litre	3	10
Nitrate	Milligrams per litre	<0.1	0.1
Oil and Grease	Milligrams per litre	5	10
pH	Milligrams per litre	9.6	6.5-8.5
Phosphorus (total)	Milligrams per litre	1.93	10
Faecal Coliforms	CFU/100ml	42	200
Total Kjeldahl Nitrogen	Milligrams per litre	3	2
Total Suspended Solids	Milligrams per litre	9	15